

XXVI Conferência TECNICALPA 2023

11, 12, 13 October 2023 – COIMBRA, Portugal

Optimization of steam management in a sulfite mill

Abstract

Pulp production is an intensive steam consumption process and steam management plays a crucial role in mill costs and optimization. Regarding this, Altri Group, owner of Caima, Celbi and Biotek pulp mills, establish a cooperation agreement with ANDRITZ to optimize several mill areas. This partnership starts in 2019 in Celbi and was then settled with the other two mills of Altri Group. This paper is related to optimization of steam management in Caima mill because there the steam flow into the process regulates the rhythms of production.

Methodology and Work

Advanced controls were implemented at the evaporation plant and digesters.

Evaporation APC delivers stable solids to the Recovery Boiler while processing the maximum amount of liquor, avoiding high temperature and pressure in the steam line, and maintaining the primary effects of evaporation at the setpoint of temperatures. Evaporation plant has priority in steam allocation due to bottlenecks. For purposes of weak liquor stock management, the APC also has a second mode that when weak liquor stock is at low levels, the rhythm of steam to the evaporation is adjusted to control it at the desired total volume from the operation staff. Secondly, at the digesters, the Steam APC implemented receives the total steam flow produced by the boilers and calculates the maximum steam available for the digesters/cooking process, so that, steam collector keeps the pressure for the process and condensing steam turbine runs with the lowest consumption possible.

Combining both APC its possible to automate and optimize the steam consumption by the two different areas insuring maximum pulp production.

Introduction

Is the purpose of this project to maximize the production of pulp. In Caima's pulp process the biggest consumers of steam are the Evaporation plant and the Digester house. Together they regulate pulp production.

To optimize production, steam management must be done so: evaporation is running at full capacity keeping safety and equipment variables in check; Condensing steam turbine is consuming the lowest steam possible (pulp production is the focus); Digesters consuming the remaining steam available keeping the previous conditions true.

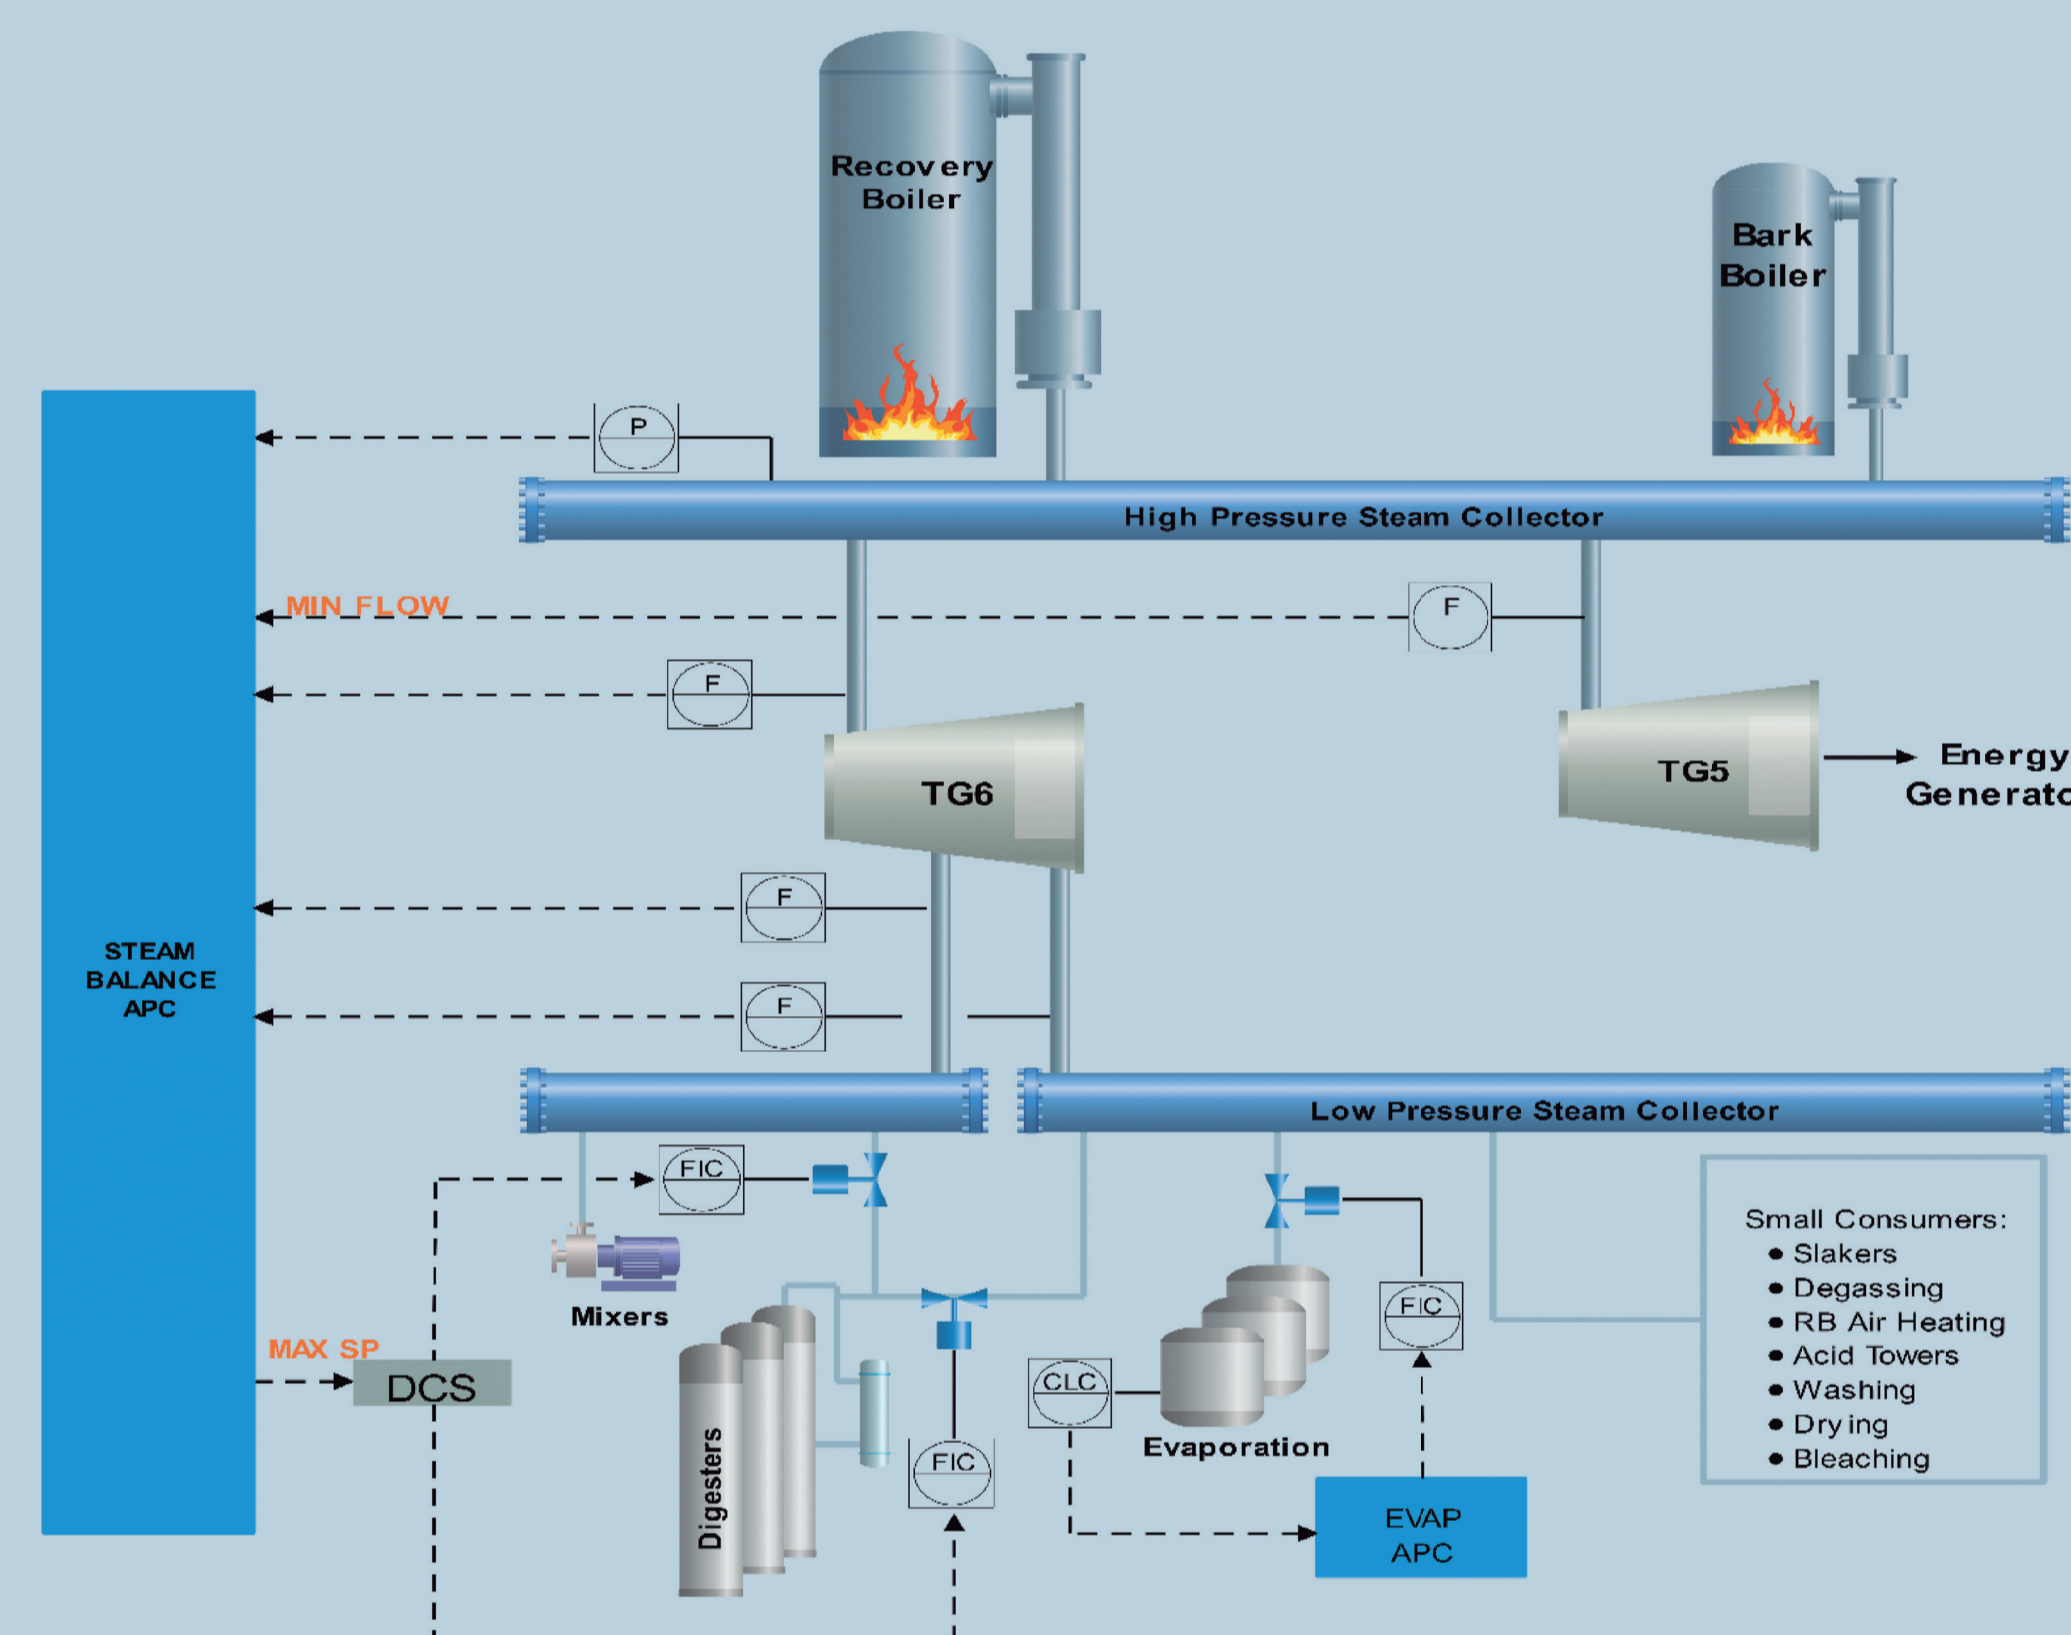


Figure 1: Block Diagram overall APC

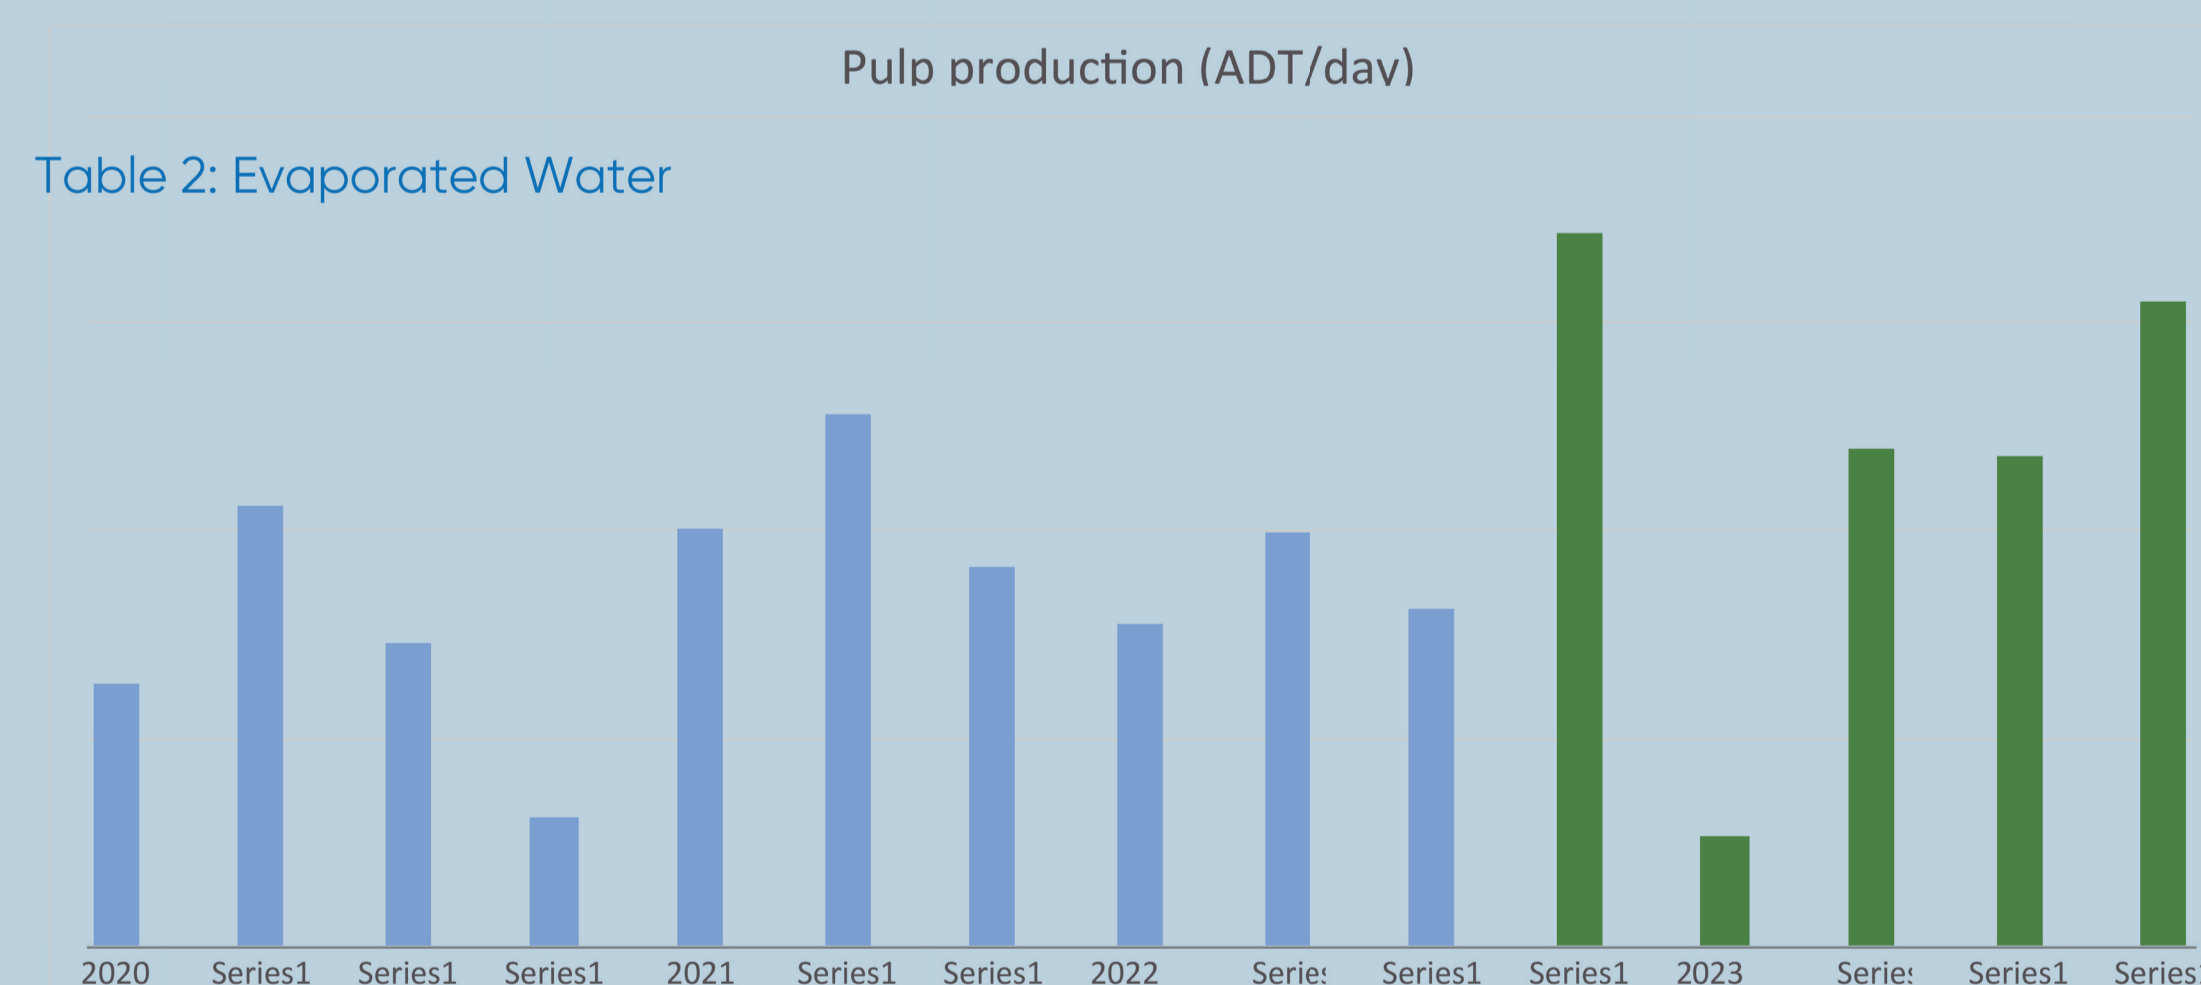
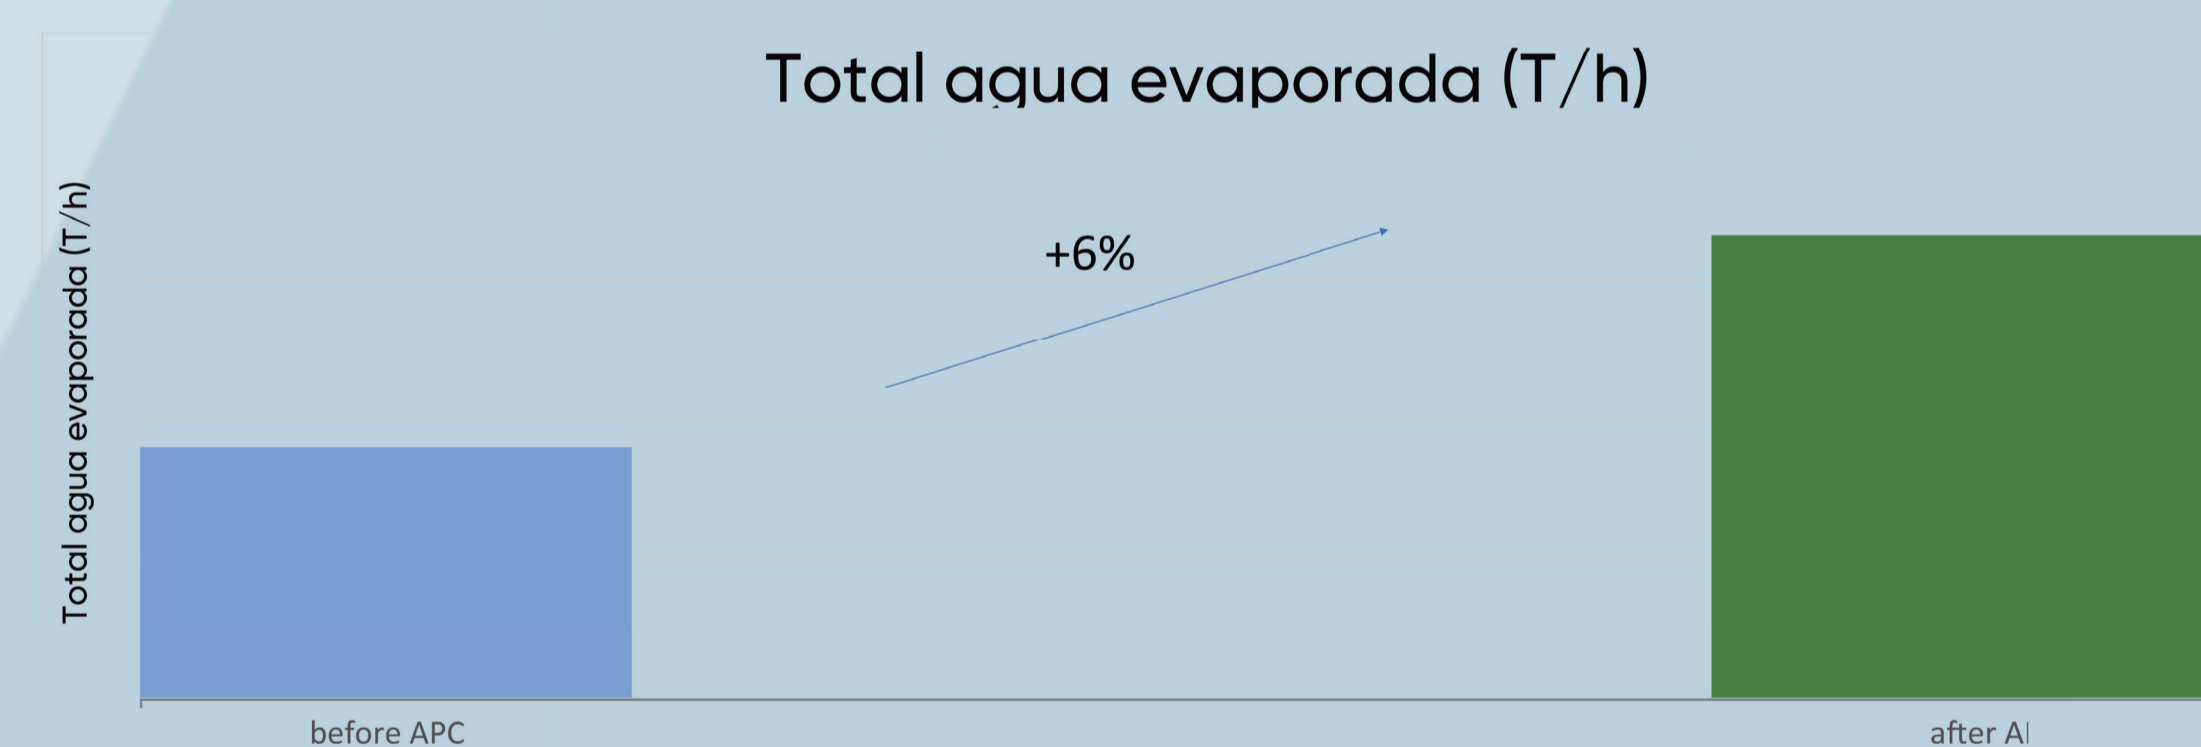


Table 2: Evaporated Water

Table 2: Pulp production

Result and Conclusion

As a result of the balance between steam allocation to Digesters – EvaporationPlant the mill was able to maximize pulp production, improve total evaporated water and minimize steam flow through condensing turbine.

During times of low output from the boilers, after the implementation of the work, steam through the turbine was reduced in 1.5 ton/h during 3 months. This steam was allocated to the process. Overall pulp production in Caima increased by 5% since implementation of project. Historically, with the Evaporation APC, the total evaporated water increased by 6% (running for 3 years). Also, steam collector pressure improved its variability, turbine maintenance problems decreased and operators are now able to focus in other tasks apart from managing the steam as it is now running automatically.

Gonçalo A. Sousa¹, Rui J. A. Lopes², Fábio M. Mendes², Ricardo M. B. Basilio², Renan P. Scarazzatti¹, Nelson D. G. Camelo³

¹ ANDRITZ SAS Sucursal em Portugal Avenida da Força Aérea Portuguesa, nº 14 3800-056 Aveiro / Portugal ; renan.scarazzatti@andritz.com (+34660641965) goncalo.sousa@andritz.com (+351912771061)

² Caima Indústria de Celulose S.A., Constância Sul, 2250-058 Constância, Portugal; rlopes@altri.pt (+351927998608), rbasilio@altri.pt (+351927998603), fabiomendes@altri.pt (+351927998571)

³ Biotek S.A., Vila Velha de Ródão, 6030-223 Vila Velha de Ródão, Portugal; nelson.camelo@altri.pt (+351932474147)